





The CMF-300 must be programmed as 'Silenceable' and 'General Alarm.'

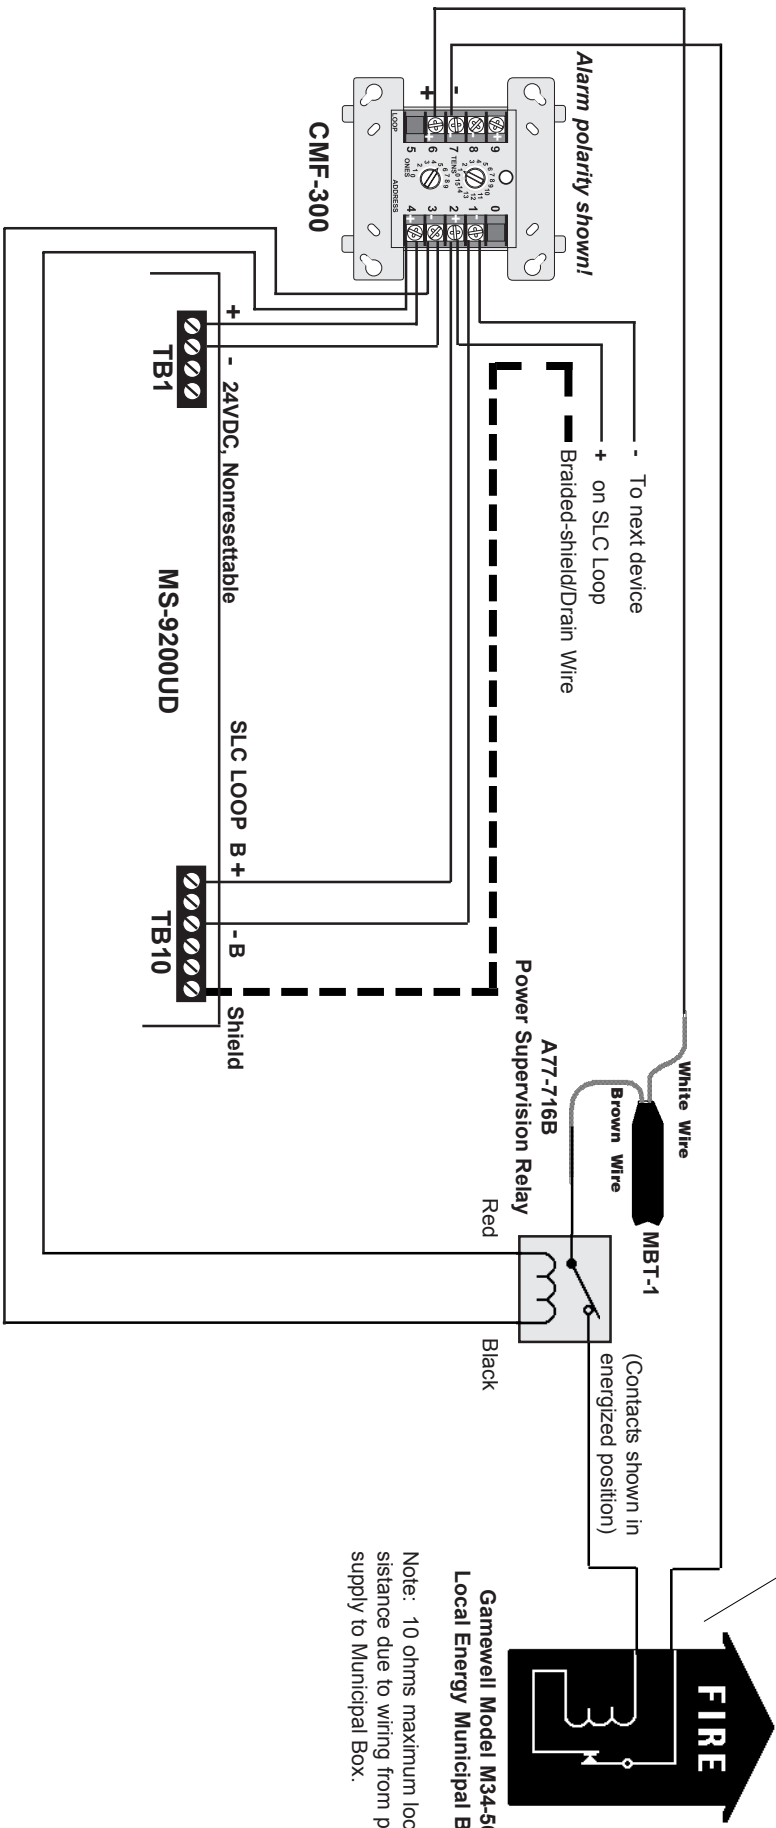

**MS-9200UD**  
**NFPA 72 Auxiliary Protective Signaling System**  
**(Alarm Signal Transmission)**

All connections are power limited and supervised. For connection of initiating devices and modules in this system, refer to the MS-9200UD Installation Manual, Document 51906. This application is not suitable for separate transmission of sprinkler supervisory or trouble conditions.

The CMF-300 must be programmed as 'Silenceable' and 'General Alarm.'

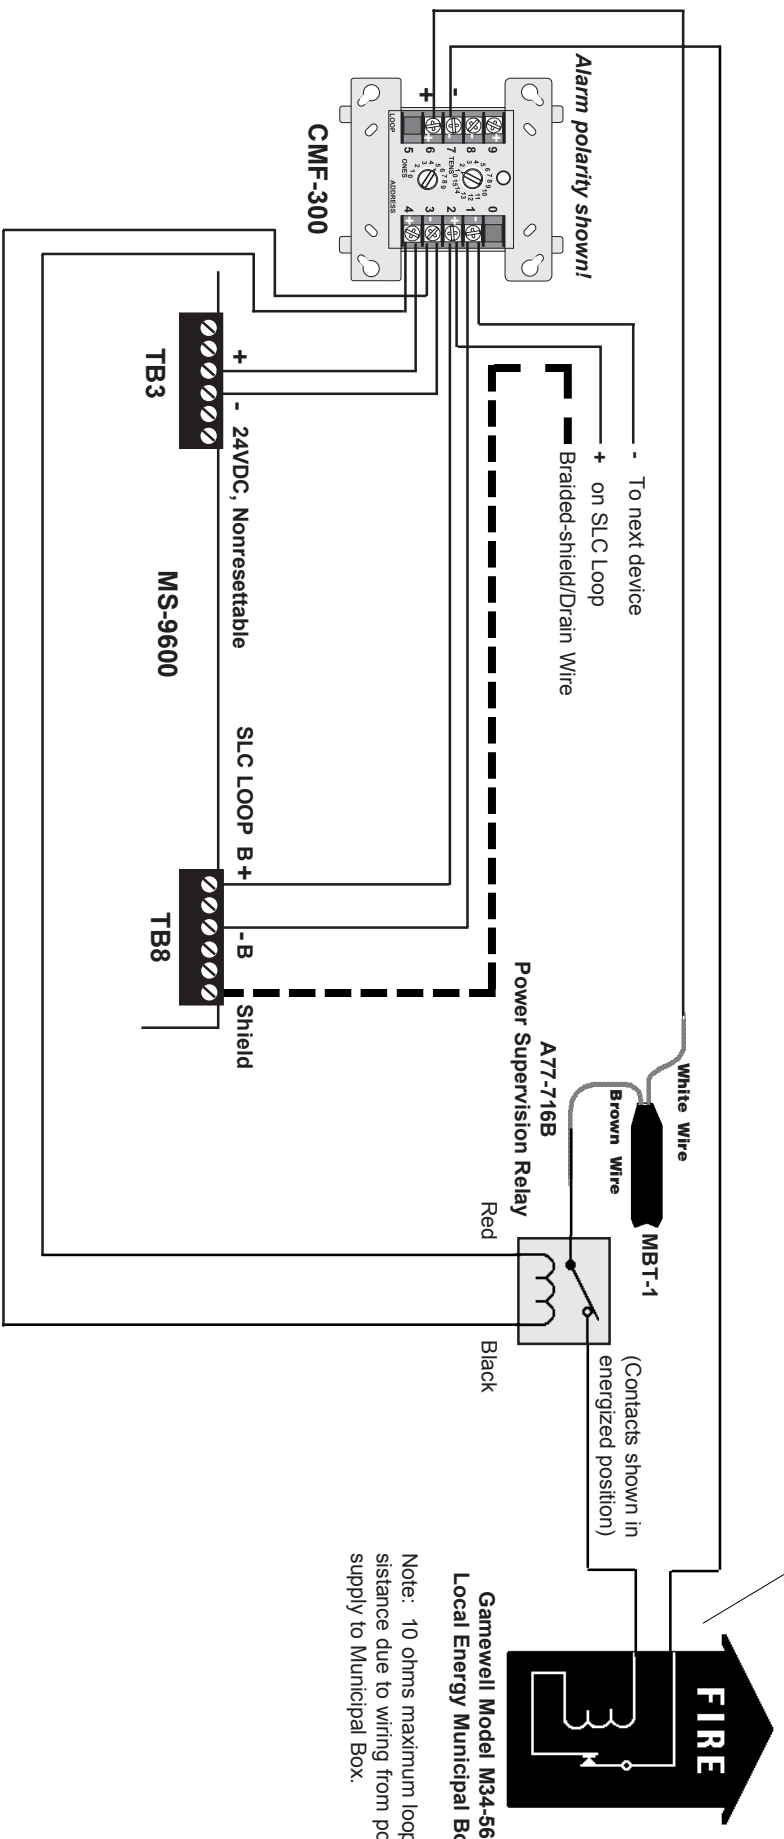

**MS-9600**  
**(Software Version 1.2 or Greater)**  
**NFPA 72 Auxiliary Protective Signaling System**  
**(Alarm Signal Transmission)**

All connections are power limited and supervised. For connection of initiating devices and modules in this system, refer to the MS-9600 Installation Manual, Document 513335. This application is not suitable for separate transmission of sprinkler supervisory or trouble conditions. **IMPORTANT!** This application, utilizing an MBT-1 and an MS-9600 FACP, is only possible when the MS-9600 has Software Version 1.2 or Greater installed.

Gamewell Model M34-56  
 Local Energy Municipal Box  
 Note: 10 ohms maximum loop resistance due to wiring from power supply to Municipal Box.