




# GEM-P800 Programming Instructions

Note: These Programming Instruction are intended to be used in conjunction with WI850, please refer to WI850A for additional information, instructions and definitions.

**NOTE:**  
After 15 minutes of keypad inactivity the keypad will emit a steady tone indicating the panel has been left in Dealer Program Mode. Enter Dealer Code to exit or press the [RESET] key to return to Dealer Program mode.

**Set Key**  
Press this key before entering a Programming Block Number.

## DEALER PROGRAM MODE - KEYPAD KEY DEFINITION

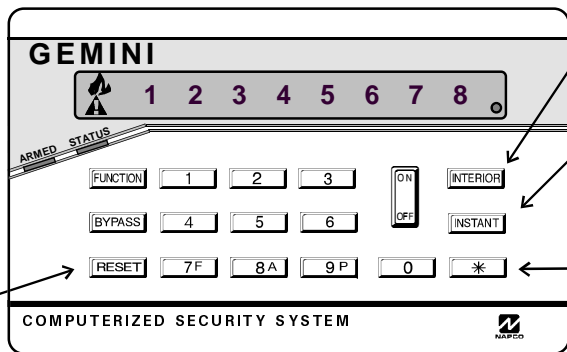

**Scroll Key**  
Use this key to scroll through data that has been entered in Programming Blocks.

**Blank Key**  
Press this key to disable all features within a LED type Programming Block or to blank out digits in a Direct Entry type Programming Block.

**Hexadecimal Data Entry**  
To Enter a hexadecimal digit enter the following:  
A = \* 1      D = \* 4  
B = \* 2      E = \* 5  
C = \* 3      F = \* 6


### DEFAULTING THE PANEL

1. Remove power from the panel.
2. Remove all wiring from terminal 15 (PGM) and terminal 3.
3. Connect terminal 15 (PGM) to terminal 3.
4. Apply power to the GEM-P800 control panel.
5. After a few seconds the ARMED, READY and SYSTEM TROUBLE LEDs will flash.
6. The keypad will beep 3 times indicating the panel default values have been loaded.
7. Remove wiring between terminal 15 (PGM) and terminal 3.
8. Re-install original wiring for terminal 15 (PGM) and terminal 3.

**Note:** Any programming in Dealer Options 1 [96] and Dealer Options 2 [97] will not be defaulted. If Dealer Code Lockout has been programmed the panel will not default the Dealer Code. The Event Log will be erased when the panel is defaulted.

## Entering Dealer Program Mode


**NOTE:**  
Entering Dealer Program Mode is not permitted while the panel is Armed, Reporting, or the Bell Output is on. To Enter Dealer Mode while the Bell is ON or the panel is Reporting or Armed; power up the panel and enter Dealer Mode within the first 3 minutes. Pressing the [RESET] key clears the 3 minute timer.



Default Dealer Code shown in parentheses

ARMED	ON	Indicates the panel is in Dealer Program Mode. The panel is ready for a programming block to be entered.
STATUS	OFF	
TROUBLE	FLASHING	

## Exiting Dealer Program Mode

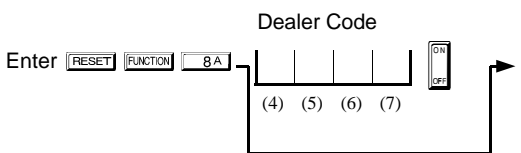

ARMED	FLASHING	Indicates the panel is Ready to exit Dealer Program Mode. Enter the Dealer Code to exit.
STATUS	FLASHING	
TROUBLE	FLASHING	

## Types of Programming Blocks

### LED Programming Block

Enable features by pressing the key that corresponds to the associated feature; the LED will turn ON. To disable a feature press the key again; the LED will turn OFF. To disable all features within a LED Type Programming Block press the **[INSTANT]** key; all LEDs will turn OFF.

#### ① LED Programming Block Example


Program zones 2 and 3 as *Follower Zones*.

1. Enter Programming Block 02, by pressing **[RESET]** (Beep), then **[0]** **[2]** (Beep).
2. Press the **[2]** key to select zone 2.
3. Press the **[3]** key to select zone 3.

02	Exit/Entry Follower
Default	
<input type="checkbox"/>	Zone 1
<input checked="" type="checkbox"/>	Zone 2
<input checked="" type="checkbox"/>	Zone 3
<input type="checkbox"/>	Zone 4
<input type="checkbox"/>	Zone 5
<input type="checkbox"/>	Zone 6
<input type="checkbox"/>	Zone 7
<input type="checkbox"/>	Zone 8

LED Type Programming Block

Zone 2 and Zone 3 LEDs are ON indicating that zones 2 and 3 have been programmed as follower zones.



### Direct Entry Programming Block

Enter data directly. For hexadecimal entries of A-F, use the **[\*]** key + **[1]** through **[6]** keys, respectively. Use the **[INSTANT]** key to blank out digits in Direct Entry type programming blocks. Default values are shown in parentheses.

#### ① Direct Entry Programming Example 1

Program the panel for a 60 second *Exit Delay*.

1. Press **[RESET]** (Beep) **[1]** **[0]** (Beep).
2. Press **[0]** **[6]** **[0]**.

10	Exit Delay
<input type="text" value="0"/>	<input type="text" value="6"/>
<input type="text" value="0"/>	<input type="text" value="0"/>
Exit Delay, seconds	
(0) (4) (5) Maximum Entry 255	

Direct Entry Type Programming Blocks

#### ② Direct Entry Programming Example 2

(Hexadecimal data entry)  
Program *Telephone Prefix Number* with a 9E.

1. Press **[RESET]** (Beep) **[4]** **[4]** (Beep).
2. Press **[9 P]**
3. Press **[\*]**
4. Press **[5]**

44	Dialing Prefix
<input type="text" value="9"/>	<input type="text" value="E"/>
<input type="text"/>	<input type="text"/>
<input type="text"/>	<input type="text"/>

<input type="checkbox"/>	ARMED	OFF	Indicates the panel is in Dealer Program Mode; the next digit entered will be interpreted as a Hexadecimal digit. Valid entries are 1-6 (A-F).
<input type="checkbox"/>	STATUS	FLASHING	
<input type="checkbox"/>	TROUBLE	FLASHING	

## Viewing Data in Programming Blocks

To view data within a programming Block enter the Program Block Number, the 1st digit will be displayed. Press the **INTERIOR** key to view the 2nd digit, continue pressing the **INTERIOR** key until all digits within the Programming Block have been viewed. Data will be displayed in the binary format shown in the table below:

Value	Data Displayed	Value	Data Displayed
0/Blank	<input type="text"/>	8	<input type="text" value="4"/>
1	<input type="text" value="1"/>	9	<input type="text" value="1 4"/>
2	<input type="text" value="2"/>	*A/0	<input type="text" value="2 4"/>
3	<input type="text" value="1 2"/>	B	<input type="text" value="1 2 4"/>
4	<input type="text" value="3"/>	C	<input type="text" value="3 4"/>
5	<input type="text" value="1 3"/>	D	<input type="text" value="1 3 4"/>
6	<input type="text" value="2 3"/>	E	<input type="text" value="2 3 4"/>
7	<input type="text" value="1 2 3"/>	F	<input type="text" value="1 2 3 4"/>

**\* NOTE:**  
In the following Programming Blocks, data that has been entered as a '0' will be displayed as an 'A':  
*Subscriber ID Numbers, Phone Numbers, Pager Leading and Trailing digits and Report Codes.*

For Technical Assistance,  
Contact the NAPCO Toll  
Free Helpline ☎  
(800) 645-9440


Zone #	Bit Value
1	1
2	2
3	4
4	8

### Example: Viewing the Dialing Prefix


A Dialing Prefix of 9E has been programmed at Programming Block Number 44 (outside access number). Follow the steps below to view the data.:

44 Dialing Prefix

① Press **RESET**   to enter Programming Block 44. The 1st digit of Programming Block 44 is displayed.

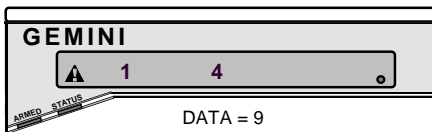

② Press the **INTERIOR** key to view the 2nd digit.

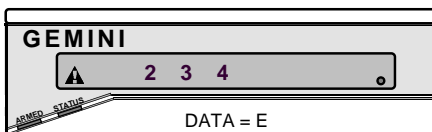

**NOTE:**  
The Following Programming Options are not permitted for UL installations: [05], [06], [23-2], [26-3] and [26-4].  
The symbol by a programming Block indicates the programming option is not permitted for UL installations.

**NOTE:**  
For information about programming blocks refer to GEM-P800 Installation Manual WI850.

## Zone Features

### 00 Exit/Entry Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 03 Auto Bypass Reentry Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 06 Open Circuit Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6

See wiring  
diagram for  
Open Circuit  
wiring.

### 09 Selective Bypass

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 01 Home/Away with Delay Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 04 24 Hour Protection Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 07 Burg (Steady) Output

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 02 Exit/Entry Follower Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

### 05 40 ms Loop Response Zones

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6

### 08 Programmable Output (PGM)

Default

Zone 1  
 Zone 2  
 Zone 3  
 Zone 4  
 Zone 5  
 Zone 6  
 Zone 7  
 Zone 8

## System Times

### 10 Exit Delay

Exit Delay, seconds  
(0) (4) (5) Maximum Entry 255

### 11 Entry Delay

Entry Delay, seconds  
(0) (3) (0) Maximum Entry 255

### 12 Burg (Steady) Output Time-out

Bell Time-out, minutes  
(0) (0) (5) Maximum Entry 255

### 13 Fire (Pulsed) Output Time-out

Bell Time-out, minutes  
(0) (0) (0) Maximum Entry 255

### 14 Test Timer Interval

Test Timer, days  
(0) (0) (1) Maximum Entry 255

### 15 Line Cut Time-to-Fail (Disabled = 000)

Line Cut Time-to-Fail, seconds  
(0) (0) (0) **Enable Feature**-Valid Entries 10-255

### 16 Wireless Supervisory Timer

Supervisory Timer, hours  
(1) (2) Maximum Entry 26

### 17 Wireless Smoke Supervisory Timer

Smoke Supervisory Timer, hours  
(8) Maximum Entry 8

### 18 Test Timer Offset

Test Timer Offset, hours  
(1) (2) Maximum Entry 23

## System Features

### 20 Keypad Features 1

Default  
  Zn 1 LED ON = \*Keypad Fire (     )  
  Zn 2 LED ON = \*Keypad AUX (     )  
  Zn 3 LED ON = \*Keypad Panic (     )  
  Zn 4 LED ON = \*Ambush (8th User Code)  
\*See Note 1

### 21 Keypad Features 2

Default  
  Zn 1 LED ON = Audible panic  
  Zn 2 LED ON = Exit/Entry with Urgency  
  Zn 3 LED ON = Display Bypass (ARMED)  
  Zn 4 LED ON = Disable Code Entry Beeps

### 22 Miscellaneous Features 1

Default  
  Zn 1 LED ON = Abort Delay  
  Zn 2 LED ON = Easy Arm/Easy Exit  
  Zn 3 LED ON = Swinger Shutdown  
  Zn 4 LED ON = Bell on Line Cut (ARMED)

#### NOTE 1:

Additional programming required for reporting. See Blocks [36]&[56].

**UL Installations:** If Keypad Fire [20-1] is enabled, the keypad must be mounted within (3) three feet from the Control Panel.

### 23 Programmable Output (PGM) Features 1

Default  
  Zn 1 LED ON = Audio Verification  
  Zn 2 LED ON = \*Access Output (   )  
  Zn 3 LED ON = \*Follow Keypad Sounder  
  Zn 4 LED ON = \*Keyfob/Keyswitch Chirp  
\*See Note 2

### 24 Programmable Output (PGM) Features 2

Default  
  Zn 1 LED ON = Fire  
  Zn 2 LED ON = AUX  
  Zn 3 LED ON = Panic  
  Zn 4 LED ON = Test Timer

### 25 Programmable Output (PGM) Features 3

Default  
  Zn 1 LED ON = AC Fail  
  Zn 2 LED ON = Low Battery  
  Zn 3 LED ON = \*Trouble  
  Zn 4 LED ON = Armed  
\*See Note 3

### 26 Miscellaneous Features 2

Default  
  Zn 1 LED ON = Momentary Keyswitch Arming  
  Zn 2 LED ON = Reserved  
  Zn 3 LED ON = Inhibit Fail to Communicate  
  Zn 4 LED ON = Inhibit Low Battery Display

#### NOTE 2:

Cannot be programmed with any other Programmable Output (PGM) Feature.

#### NOTE 3:

Includes Bell Cut, Fire Trouble, Receiver Fail-to-Respond, Receiver Tamper, Receiver JAM, Transmitter Low Battery, Transmitter Supervisory Failure, Wireless Smoke Low Battery and Wireless Smoke Supervisory Failure.

# Telephone Number 1 Programming

## 30 Subscriber ID Number

--	--	--	--	--

## 31 Telephone Number 1

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

**NOTE:**  
A fixed Dial Tone Detection (E) is included prior to the *Dialing Prefix* (Block Number 44). Programming an E is not required for Telco 1, Telco 2 and Telco 3. If dial tone detection is not desired select *No Dial Tone Detection* in Communicator Features (Block Number 46). Program a D if a 4 second delay is required.

## 32 Receiver Format

- |     |                      |
|-----|----------------------|
| [0] | Disabled             |
| [1] | Ademco Slow          |
| [2] | Radionics Slow       |
| [3] | Silent Knight Fast   |
| [4] | Universal High Speed |
| [5] | Reserved             |
| [6] | Point ID             |
| [7] | Pager                |

→ 

--

  
(4)

## 33 Receiver Options

- Default
- Zn 1 LED ON = 2300 Hz Handshake/Kissoff
- Zn 2 LED ON = Sumcheck
- Zn 3 LED ON = Single Digit
- Zn 4 LED ON = No Handshake

## 34 Zone Report, Telco 1

- Default
- Zone 1
- Zone 2
- Zone 3
- Zone 4
- Zone 5
- Zone 6
- Zone 7
- Zone 8

## 35 Zone Restore Report, Telco 1

- Default
- Zone 1
- Zone 2
- Zone 3
- Zone 4
- Zone 5
- Zone 6
- Zone 7
- Zone 8

## 36 System Reporting, Telco 1

- Default
- Zn 1 LED ON = \*KP Fire ( 7F  \*)
- Zn 2 LED ON = \*KP AUX ( 8A  \*) / Ambush
- Zn 3 LED ON = \*KP Panic ( 9P  \*)
- Zn 4 LED ON = Test Timer

## 37 System Reporting, Telco 1

- Default
- Zn 1 LED ON = AC Fail Report (15 min. report delay)
- Zn 2 LED ON = Low Battery Report
- Zn 3 LED ON = \*Trouble Report
- Zn 4 LED ON = Fire Report
- \*See Note 2

## 38 System Restore Report, Telco 1

- Default
- Zn 1 LED ON = AC Restore Report
- Zn 2 LED ON = Battery Restore Report
- Zn 3 LED ON = Trbl Restore Report
- Zn 4 LED ON = Fire Restore Report

## 39 Opening Closing Report, Telco 1

- Default
- Zn 1 LED ON = User 1 Reporting
- Zn 2 LED ON = User 2 Reporting
- Zn 3 LED ON = User 3 Reporting
- Zn 4 LED ON = User 4 Reporting
- Zn 5 LED ON = User 5 Reporting
- Zn 6 LED ON = User 6 Reporting
- Zn 7 LED ON = User 7 Reporting
- Zn 8 LED ON = User 8 Reporting

**NOTE 1:**  
Requires features to be enabled, see block [20].

**NOTE 2:**  
Includes Bell Cut, Fire Trouble, Receiver Fail-to-Respond, Receiver Tamper, Receiver JAM, Transmitter Low Battery, Transmitter Supervisory Failure, Wireless Smoke Low Battery, Wireless Smoke Supervisory Failure.

ZONE 3 TX LOW BATTERY    \*RF TRAN LOW BAT, ZN03\*  
SMOKE 2 LOW BATTERY    \*RF TRAN LOW BAT, ZN10\*

## Backup Telephone Programming

### 40 Subscriber ID Number (Telco 2)

--	--	--	--	--	--	--

### 41 Telephone Number 2

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

#### Note:

A fixed Dial Tone Detection (E) is included prior to the *Dialing Prefix* (Block Number 44). Programming an E is not required for Telco 1, Telco 2 and Telco 3. If dial tone detection is not desired select *No Dial Tone Detection* in Communicator Features (Block Number 46). Program a D if a 4 second delay is required.

### 42 Receiver Format

- |     |                      |
|-----|----------------------|
| [1] | Ademco Slow          |
| [2] | Radionics Slow       |
| [3] | Silent Knight Fast   |
| [4] | Universal High Speed |
| [5] | Reserved             |
| [6] | Point ID             |
| [7] | Pager                |

→ 

--

  
(4)

### 43 Receiver Options

Default

- ON  Zn 1 LED ON = 2300 Hz Handshake/Kissoff  
 OFF  Zn 2 LED ON = Sumcheck  
 OFF  Zn 3 LED ON = Single Digit  
 OFF  Zn 4 LED ON = No Handshake

### 44 Dialing Prefix

--	--	--	--	--	--	--

Dialing Prefix for Telco 1, Telco 2 & Telco 3.

### 45 Communicator Features 1

Default

- ON  Zn 1 LED ON = Communicator Enabled  
 ON  Zn 2 LED ON = DTMF w/ Rotary Backup  
 OFF  Zn 3 LED ON = DTMF only  
 OFF  Zn 4 LED ON = Backup to Telco 2

### 46 Communicator Features 2

Default

- OFF  Zn 1 LED ON = No Dial Tone Detection  
 OFF  Zn 2 LED ON = 2:1 Rotary Dialing  
 OFF  Zn 3 LED ON = Backup if < 4 attempts  
 OFF  Zn 4 LED ON = Reserved

## Pager Programming

### 47 Leading Digits

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

(0) (0) (0) (0)

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

### 48 Trailing Digits

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

\*(C) \*See Note 1

### 49 Pager Option

Default

- OFF  Zn 1 LED ON = Skip Alarm Data  
 OFF  Zn 2 LED ON = Reserved  
 OFF  Zn 3 LED ON = Reserved  
 OFF  Zn 4 LED ON = Reserved

#### Note 1:

C = TouchTone #. This is the typical terminating digit for most paging systems. Recommended, but may not be required by paging system. D = 2 second delay.

## Telephone Number 3 Programming

### 50 Subscriber ID Number

### 51 Telephone Number 3

**NOTE:**

A fixed Dial Tone Detection (E) is included prior to the *Dialing Prefix* (Block Number 44). Programming an E is not required for Telco 1, Telco 2 and Telco 3. If dial tone detection is not desired select *No Dial Tone Detection* in Communicator Features (Block Number 46). Program a D if a 4 second delay is required.

### 52 Receiver Format

- [0] Disabled
- [1] Ademco Slow
- [2] Radionics Slow
- [3] Silent Knight Fast
- [4] Universal High Speed
- [5] Reserved
- [6] Point ID
- [7] Pager

→  (4)

### 53 Receiver Options

## Default

- ON  Zn 1 LED ON = 2300 Hz Handshake/Kissoff
- OFF  Zn 2 LED ON = Sumcheck
- OFF  Zn 3 LED ON = Single Digit
- OFF  Zn 4 LED ON = No Handshake

### 54 Zone Report, Telco 3

## Default

- OFF  Zone 1
- OFF  Zone 2
- OFF  Zone 3
- OFF  Zone 4
- OFF  Zone 5
- OFF  Zone 6
- OFF  Zone 7
- OFF  Zone 8

### 55 Zone Restore Report, Telco 3

## Default

- OFF  Zone 1
- OFF  Zone 2
- OFF  Zone 3
- OFF  Zone 4
- OFF  Zone 5
- OFF  Zone 6
- OFF  Zone 7
- OFF  Zone 8

### 56 System Reporting, Telco 3

## Default

- OFF  Zn 1 LED ON = \*KP Fire ( 7F  \*  )
- OFF  Zn 2 LED ON = \*KP AUX ( 8A  \*  )/Ambush
- OFF  Zn 3 LED ON = \*KP Panic ( 9P  \*  )
- OFF  Zn 4 LED ON = Test Timer

\*See Note 1

### 57 System Reporting, Telco 3

## Default

- OFF  Zn 1 LED ON = AC Fail Report (15 min. report delay)
  - OFF  Zn 2 LED ON = Low Battery Report
  - OFF  Zn 3 LED ON = \*Trouble Report
  - OFF  Zn 4 LED ON = Fire Report
- \*See Note 2

### 58 System Restore Report, Telco 3

## Default

- OFF  Zn 1 LED ON = AC Restore Report
- OFF  Zn 2 LED ON = Battery Restore Report
- OFF  Zn 3 LED ON = Trbl Restore Report
- OFF  Zn 4 LED ON = Fire Restore Report

### 59 Opening Closing Report, Telco 3

## Default

- OFF  Zn 1 LED ON = User 1 Reporting
- OFF  Zn 2 LED ON = User 2 Reporting
- OFF  Zn 3 LED ON = User 3 Reporting
- OFF  Zn 4 LED ON = User 4 Reporting
- OFF  Zn 5 LED ON = User 5 Reporting
- OFF  Zn 6 LED ON = User 6 Reporting
- OFF  Zn 7 LED ON = User 7 Reporting
- OFF  Zn 8 LED ON = User 8 Reporting

**NOTE 1:**

Requires features to be enabled, see block [20].

**NOTE 2:**

Includes Bell Cut, Fire Trouble, Receiver Fail-to-Respond, Receiver Tamper, Receiver JAM, Transmitter Low Battery, Transmitter Supervisory Failure, Wireless Smoke Low Battery, Wireless Smoke Supervisory Failure.

ZONE 3 TX LOW BATTERY    \*RF TRAN LOW BAT, ZN03\*  
 SMOKE 2 LOW BATTERY    \*RF TRAN LOW BAT, ZN10\*



## Report Codes

### 60 Zone Report Codes

Zone 1 Alarm Code

(3) ←

Zone 2 Alarm Code

(3)

Zone 3 Alarm Code

(3)

Zone 4 Alarm Code

(3)

Zone 5 Alarm Code

(3)

Zone 6 Alarm Code

(3)

Zone 7 Alarm Code

(3)

Zone 8 Alarm Code

(3)

#### NOTE:

The second digit of the Report Code is the number of the zone that is reporting. For example zone 5 report code (default of 3) would be 35.

### 61 Point ID Report Codes

Zone 1 Alarm Code

(3) ←

Zone 2 Alarm Code

(3)

Zone 3 Alarm Code

(3)

Zone 4 Alarm Code

(3)

Zone 5 Alarm Code

(3)

Zone 6 Alarm Code

(3)

Zone 7 Alarm Code

(3)

Zone 8 Alarm Code

(3)

- 1 FIRE
- 2 PANIC
- 3 BURGLARY
- 4 HOLDUP
- 5 GENERAL ALARM
- 6 RESERVED
- 7 GAS ALARM
- 8 HEAT ALARM
- 9 RESERVED
- A AUXILIARY
- B 24 HOUR ALARM

### 62 Zone Codes

Zone 1, 2, 3, 4, 5, 6, 7 & 8 Restore Code

(E)

Zone 1, 2, 3, 4, 5, 6, 7 & 8 Trouble Code

(F)

### 63 System Report Codes

Keypad Fire (  7F  \* )

(1) (1)

Keypad AUX (  8A  \* )

(2) (3)

Keypad Panic (  9P  \* )

(2) (1)

Test Timer

(F) (F)

AC Fail

(F) (9)

Low Battery

(F) (8)

\*Trouble

(F) (1)

Fire

(1) (1)

\*See Note 1

### 64 System Restore Code

(E)

#### NOTE 1:

Includes Bell Cut, Fire Trouble, Receiver Fail-to-Respond, Receiver Tamper, Receiver JAM, Transmitter Low Battery, Transmitter Supervisory Failure, Wireless Smoke Low Battery and Wireless Smoke Supervisory Failure.

### 65 Opening and Closing Code

(C) Closing Code

(B) Opening Code

### 66 Ambush Report Code

(2) (2)

## Enhanced Communicator Features

### 67 Telephone Number 1

Default

OFF |  Zn 1 LED ON = Opening after Alarm (Cancel Code)

OFF |  Zn 2 LED ON = Conditional Closing

OFF |  Zn 3 LED ON = Reserved

OFF |  Zn 4 LED ON = Reserved

### 68 Telephone Number 3

Default

OFF |  Zn 1 LED ON = Opening after Alarm (Cancel Code)

OFF |  Zn 2 LED ON = Conditional Closing

OFF |  Zn 3 LED ON = Reserved


OFF |  Zn 4 LED ON = Reserved

# Wireless

## Transmitters

	RF ID #	Point
71 Zone 1	:	
72 Zone 2	:	
73 Zone 3	:	
74 Zone 4	:	
75 Zone 5	:	
76 Zone 6	:	
77 Zone 7	:	
78 Zone 8	:	

Enter the RF ID# located on the Transmitter, Key Fob and Smoke Detector labels.



RF ID # XXXXXX:X


Enter the point number to be associated with the zone. If only one point of GEM-TRANS2 is used, enter a 1 in this location. For GEM-GB, GEM-DT, GEM-PIR enter a 1 in this location.

## Programming Example

Map point 1 of a window door transmitter, with RF ID# 0012B0:0 to Zone 3.

73 Zone 3    0 | 0 | 1 | 2 | B | 0 | : 0    1

1. Enter Dealer Mode.
2. Enter **RESET** (beeps) **7F** **3** (beeps)
3. Enter **0** **0** **1** **2** **\*** **2** **0** **0**
4. Enter **1** (beeps)



Note: If the RF ID# in step 3 is not entered correctly the keypad will emit a 1 second tone indicating incorrect entry. Repeat steps 2 - 4 above.

## Keyfobs

	RF ID #	AUX 1	AUX 2
81 Keyfob 1	:		
82 Keyfob 2	:		
83 Keyfob 3	:		
84 Keyfob 4	:		

- AUX 1 & 2 Programming**
- 1 Panic
  - 2 AUX
  - 3 Bell ON
  - 4 PGM
  - 5 Instant
  - 6 Access on PGM
  - 7 Full Set System
  - 8 Interior

## Smoke Detectors

	RF ID #
85 Smoke 1	:
86 Smoke 2	:
87 Smoke 3	:
88 Smoke 4	:

## Hexadecimal Data Entry

To Enter a hexadecimal digit enter the following: A= **\*** **1**    B= **\*** **2**    C= **\*** **3**    D= **\*** **4**    E= **\*** **5**    F= **\*** **6**

## Downloading

### 90 Callback Telephone Number

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

### 91 Ring Count

--	--

(0) (9) Maximum Entry 15

### 92 Downloading Features

Default

ON  Zn 1 LED ON = Ring Method

OFF  Zn 2 LED ON = Answering Machine override

OFF  Zn 3 LED ON = Function 6 (FUNCTION 6) Download

OFF  Zn 4 LED ON = Signal Strength Test Mode

### 93 Auto Download ID Number

--	--

## Dealer Programming

### 94 Dealer Code

--	--	--	--

(4) (5) (6) (7)

### 95 User 1 Code

--	--	--	--

(1) (2) (3) (4)

### 96 Dealer Options 1

Default

OFF  Zn 1 LED ON = Dealer Code Lockout

ON  Zn 2 LED ON = User 1 Code Lockout

OFF  Zn 3 LED ON = UL Household Fire

OFF  Zn 4 LED ON = Fire Trouble on Fire LED

### 97 Dealer Options 2

Default

OFF  Zn 1 LED ON = \*International Dialing Protocol

OFF  Zn 2 LED ON = \*Invert Bell Output

OFF  Zn 3 LED ON = System Trouble Auto Reset

OFF  Zn 4 LED ON = User 1 Code-Program only

\*See Note 1

### 98 Number of Re-Dials

--

(9)

#### NOTE 1:


International Features

# GEM-P800 WIRING DIAGRAM

(REFER TO INSTALLATION INSTRUCTIONS W1850)



This equipment should be installed in accordance with Chapter 2 of the National Fire Alarm Code, ANSI/NFPA 72-1993 (National Fire Protection Association Batterymarch Park, Quincy MA 02269), and local codes. Information describing proper installation, operation, testing, maintenance, evacuation planning, and repair service is to be provided with this equipment. UL Listed Energy Cable is required.




**RESIDENTIAL BURG (4 HOUR STANDBY)**  
COMBINED STANDBY = 500 mA    BELL = 2.0 AMP

**RESIDENTIAL FIRE (4 HOUR STANDBY)<sup>(2)</sup>**  
COMBINED STANDBY = 500 mA    BELL = 65 mA

**RESIDENTIAL FIRE (24 HOUR STANDBY)<sup>(3)</sup>**  
COMBINED STANDBY = 120 mA    BELL = 95 mA

ALL OUTPUTS ARE CURRENT LIMITED

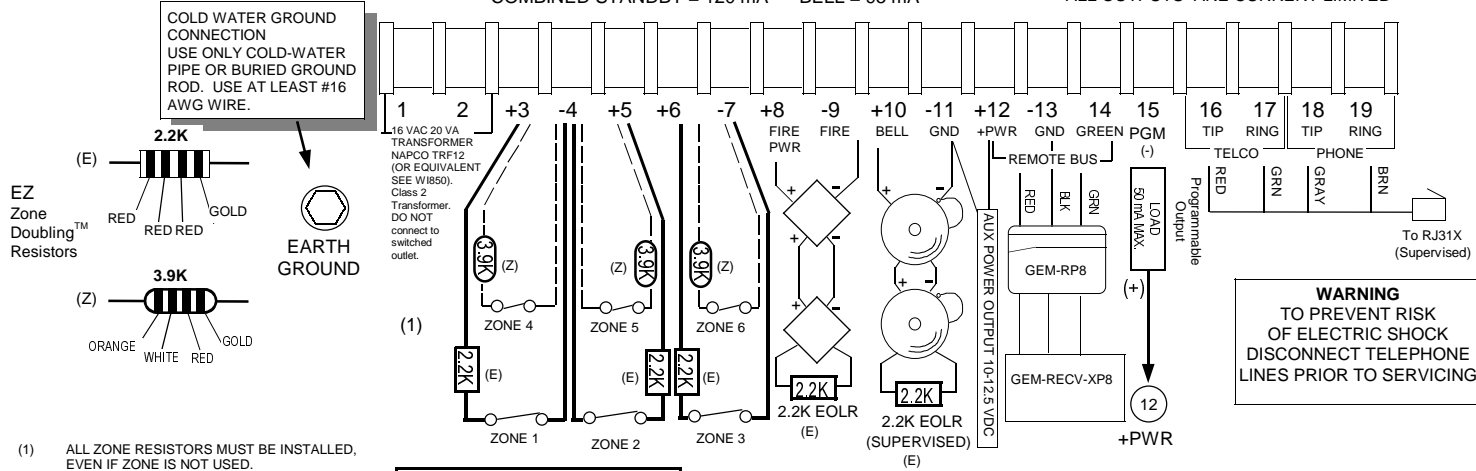

- (1) ALL ZONE RESISTORS MUST BE INSTALLED, EVEN IF ZONE IS NOT USED.
- (2) COMBINED STANDBY = KEYPAD CURRENT + AUX POWER CURRENT + FIRE POWER + PGM CURRENT.
- (3) 24 HOUR STANDBY REQUIRES A 7AH BATTERY.

